



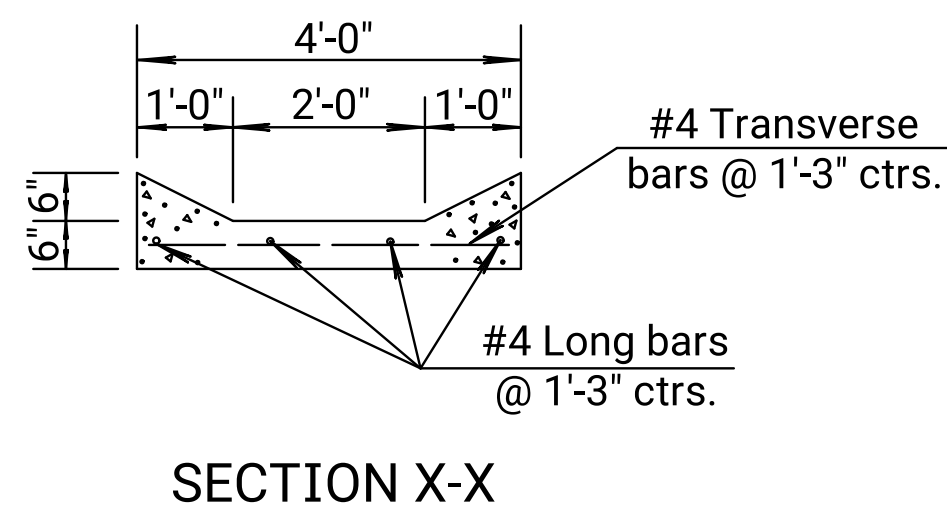


Note: Use Concrete Grade 3.0 (AE) throughout.
The entire area of the Slope Drain (Special) below the curbs, to be poured and struck off with a uniform thickness of 6". The curbs are to be applied in the same manner and using the same methods as for edge curb.
Reinforcing steel to be deformed #4 bars.

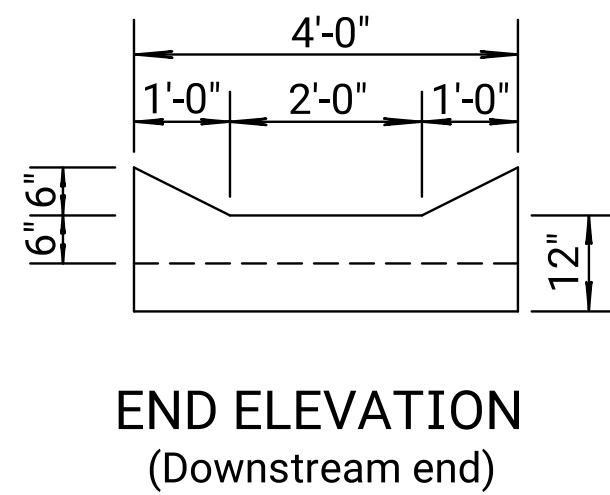

PLAN

Δ Where the valley gutter does not abut concrete pavement or concrete base course, omit tie bars and Longitudinal construction joint.

▮ Welded wire can be substituted with a macro fiber. See standard specifications for macro fiber and dosage requirements.

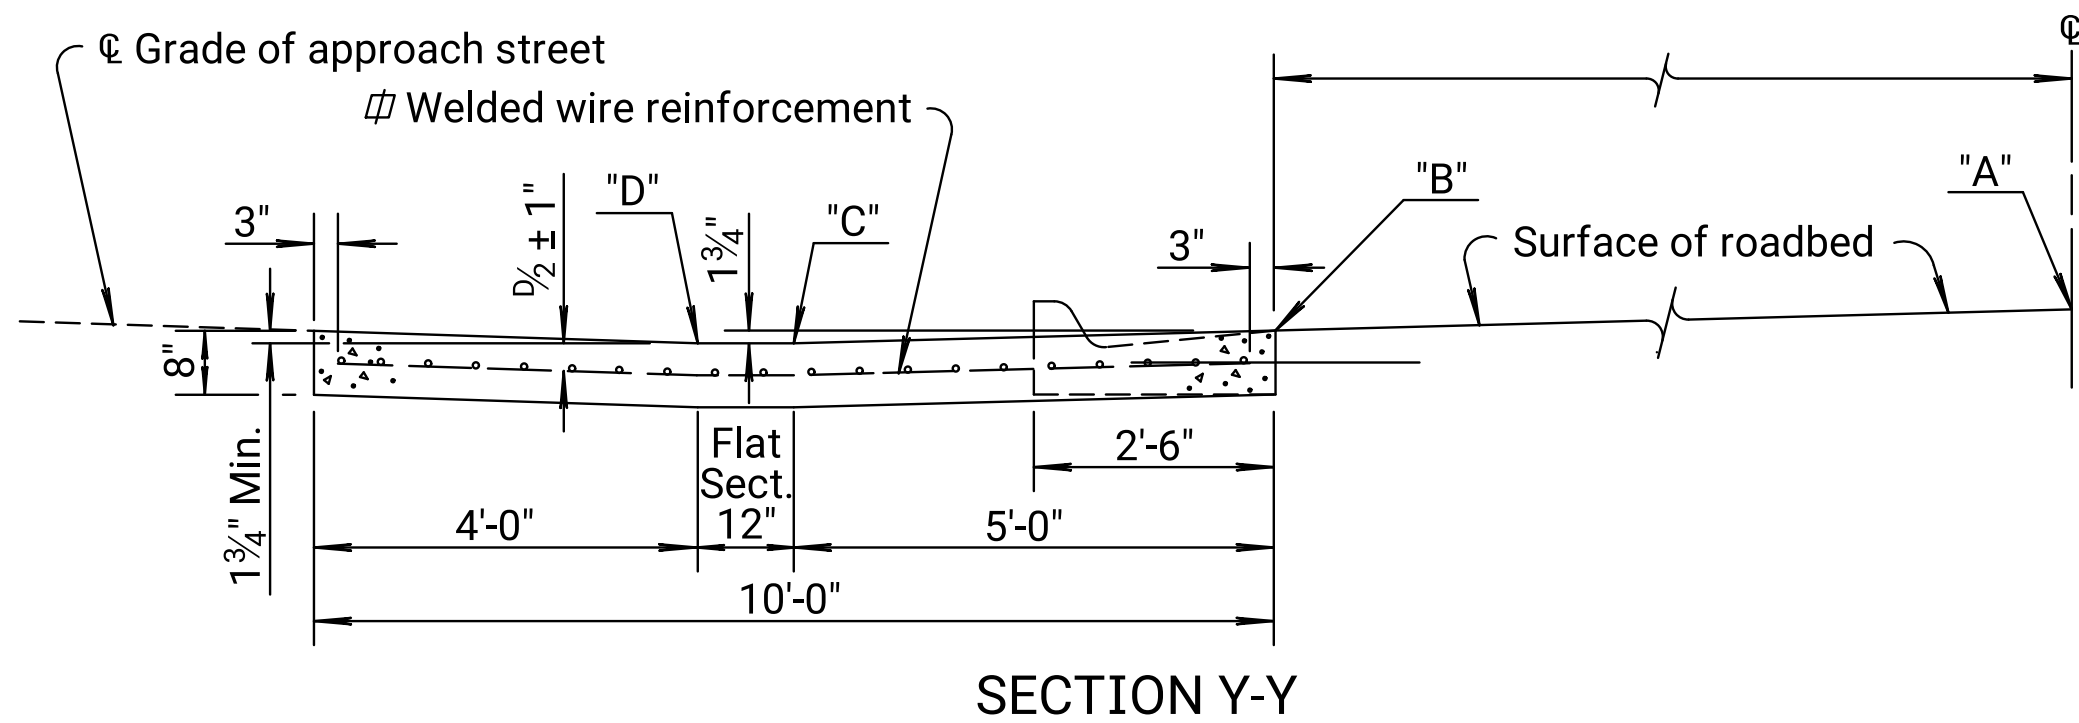[illegible]

VALLEY GUTTER

KANSAS DEPARTMENT OF TRANSPORTATION			
CONCRETE PAVEMENT AUXILIARY DETAILS-II			
RD722			
FHWA APPROVAL		06-01-11	APP'D.
DESIGNED		DETAILS	QUANTITIES
DESIGN CK.		DETAIL CK.	TRACE CK.
		James O. Brewer	